Westlock Pharma II and AccuTrak 9881 provide position and control monitoring for linear sanitary diaphragm valves. They are both weatherproof and the Pharma II offers network connectivity.



Technical data	
Agency approvals	
Enclosure standards (IEC)	
Pharma II	IP55
Switches	
Pharma II 99P2	Hermetically sealed dry contact switch elements
Pharma II 76P2/77P2	Hall effect sensors
AccuTrak 9881	Magnum (hermetically sealed proximity type) switches
Enclosures	
Pharma II	Engineered resin
AccuTrak 9881	Aluminum



Features Pharma II


- Compact 95 mm height (without solenoid).
- Low profile and tool-free access ideal for short bend radius installations.
- Non-contact, solid state Hall effect sensors provide premium reliability, even in high cycle applications.
- Zero current leakage means excellent performance in low current I/O systems.
- QuickSwap twist lock installation allows easy integration of puck style solenoid valve base.
- QuickSwap conventional and network electronic modules.
- Easy access to terminal strip for internal wiring.
- Modular design allows the quick change out of electronics/switch module or solenoid.
- Network connectivity via DeviceNet[™] (76P2) and AS-Interface[®] (77P2) protocols.

AccuTrak 9881

- Mounting kits available for all sanitary actuators.
- Mechanical visual position indicator available as an option.
- Terminal strips are pre-wired and numbered with generous working space for ease of use and extra wiring points for solenoid integration.
- Aluminum enclosures with low copper content (0.2% max.) ensure robust performance in corrosive environments.
- Thumbscrew trigger adjustments allow quick and simple hand setting of position sensors.
- Eliminator integrated coupling option for attachment of solenoid valve.

Pharma II 99P2/76P2/77P2

Non-hazardous Position and Control Monitors

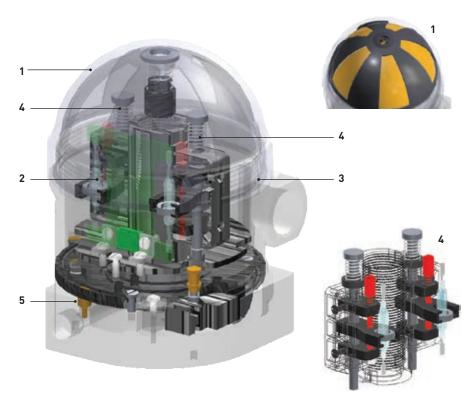

1. High definition visual indicator

The patent pending design of the HDVI allows 360° viewing from up to 100 feet away. The HDVI is also self-setting for all stroke lengths. It is incorporated as an integral part of the screw top, easy access enclosure.

2. 99P2: Hermetically sealed bifurcated dry contact switch elements.

76P2/77P2: Hall effect sensors offer enhanced reliability in extreme environments. As there are no moving parts in the sensor or magnet, they typically have a longer life than traditional switches.

3. Tool-free access with screw top cover.


4. Self-setting limit switches

Self-setting position limit switch assembly is engineered to reduce control room nuisance alarms and false trips created by changes in seat durometer.

5. Solenoid spool design

Integrated puck style base mounted solenoid.

Pharma II dimensions

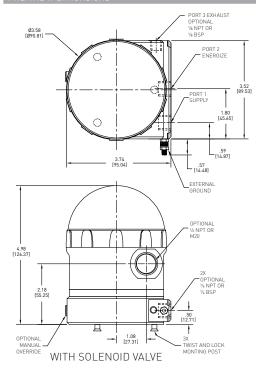

Dimensions in inches, where available metric dimension (mm) in parentheses.

Technical specifications	
Materials of construction	
Enclosure	Engineered resin
Beacon	Co-polyester
Solenoid valve	Stainlesss steel (with engineered resin block)
Available switches	
99P2	Hermetically sealed bifurcated dry contact switch elements
76P2/77P2	Hall effect sensors

Ø3.58 [Ø90.81

> 3.73 [94.62]

TWIST AND LOCK MONTING POST

WITHOUT SOLENOID VALVE

Notes

OPTIONAL ½ NPT OR M20

.93
[23.50]

ł

1.08 [27 31]

Mounting kits


Mounting kits sold separately; please contact your local sales representative for mounting kit part numbers and pricing.

Switches and sensors

For further information see our switches and sensors data sheet.

Technical chocification

AccuTrak 9881 dimensions

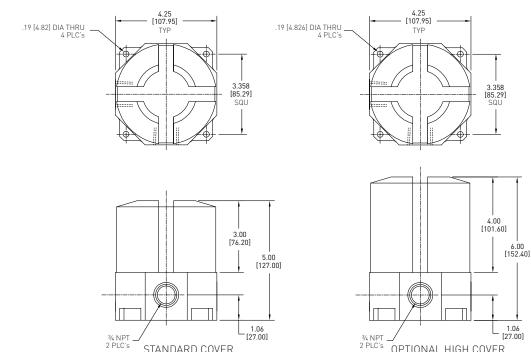

STANDARD COVER

Dimensions in inches, where available metric dimension (mm) in parentheses.

Technical specifications

Materials of construction

Enclosure

Available switches

Aluminum with powder coat finish

OPTIONAL HIGH COVER

Magnum, SPDT hermetically sealed switches with tungsten contacts

Notes

Sanitary valve ordering code

(see selection guide)

Switches and sensors

For further information see our switches and sensors data sheet.

Mounting kits

Mounting kits sold separately; please contact your local sales representative for mounting kit part numbers and pricing.

Specifying your control monitor

Specifying a control monitor is a complex process as there are many variables which affect each individual application. To ensure that you receive the best possible combination for your control and monitoring requirement, please contact your local sales office for advice and guidance from one of our experts.

Hazardous area classification

Please see our data sheet for further information on the global standards affecting the specification and installation of equipment in hazardous areas.

Copyright © Westlock. All rights reserved

Sanitary Valve Position and Control Monitors

Selection Guides

	na ll										
	nodel										
	Pharma										
	DeviceN		0 (for you	cion 2 0 contr	et vour salos	roprocontatival					
/ Г Z		S-Interface® v3.0 (for version 2.0 contact your sales representative)									
	Conduit size 1A One ½" NPT (F) fitted with gland fitting										
						at available with	L 00D2)				
			One ½" NPT (F) fitted with mini-connector (not available with 99P2) One ½" NPT (F) fitted with micro-(Euro) connector (not available with 99P2) One M20								
	2G	One ½" NPT (F) and one ½" NPT (M) eliminator fitting									
		Solenoid coil voltage									
		0	None								
		D	24 V D0								
		А	120 V A	.C (99P2 only)							
			Spo	ol valve							
				None							
			550		ay, stainless st	eel					
				Overrid	e option						
				0 No							
					ocking						
5P2	1M	D	550) [=]	Model numb	er 76P21M05	500L				
- cu-T	rak 988	21									
_		51									
	nodel										
381	Aluminu	m enclos	ure								
	Shaf	t output									
	0	None									
		Bea	con								
		00	No indi	cator							
		MI	Mechar	nical indicator	(not available	on all applicatio	ins)				
			Cond 1B	duit							
						d when ordered v	with Falcon sole	enoid valve	below)		
				B Two ¾" NPT E One ¾" NPT							
			2E		(F) and one 9		nator fitting*				
					y valve orderii	ng coue					
				Sanitary XXXX		-					
					y valve orderin Model Code	-					
					Model Code	e Valve Size	ASEPC		lve Size	SAUNDERS	Valve Size
					Model Code ITT 1001	e Valve Size ¼" (Biotek)	A001	1/2	9	S001	1/4"
					Model Code LTT 1001 1002	e Valve Size ¼" (Biotek) ½"	A001 A002	1/2 [°] 1″		S001 S002	1/4" 1/2"
					Model Code LTT 1001 1002 1003	e Valve Size ¼" (Biotek) ½" ¾"	A001 A002 A003	1/2 [°] 1″ 2″		S001 S002 S003	1/4" 1/2" 3/4"
					Model Code ITT 1001 1002 1003 1004	e Valve Size ¼" (Biotek) ½"	A001 A002	1/2 [°] 1″		S001 S002	1/4" 1/2"
					Model Code LTT 1001 1002 1003 1004 1005 1006	e Valve Size 1/4" (Biotek) 1/2" 1" 11/2" 11/2" 11/2" Style 33	A001 A002 A003 A004 GEMU	1/2' 1" 2" 3" Va	lve Size	S001 S002 S003 S004	1/4" 1/2" 3/4" 1"
					Model Code ITT 1001 1002 1003 1004 1005 1006 1007	e Valve Size V/a" (Biotek) 1/2" 3/4" 1" 11/2" 11/2" 11/2" Style 33 2"	A001 A002 A003 A004	V2 1" 2" 3" Va V2	I lve Size * to ½" Style 605	S001 S002 S003 S004 S005	1/4" 1/2" 3/4" 1" 1 1/2"
					Model Code ITT 1001 1002 1003 1004 1005 1006 1007 1008	e Valve Size 1/2" (Biotek) 1/2" 3/4" 1" 11/2" Style 33 2" 2" Style 33	A001 A002 A003 A004 GEMU G001	12" 2" 3" Va ½2" 3/8	I lve Size " to ½" Style 605 " to ¾" Style 625	S001 S002 S003 S004 S005	1/4" 1/2" 3/4" 1" 1 1/2"
					Model Code ITT 1001 1002 1003 1004 1005 1006 1007	e Valve Size 1/4" (Biotek) 1/2" 3/4" 1" 11/2" Style 33 2" 2" Style 33 3" and 4" Style	A001 A002 A003 A004 GEMU G001	V2 1" 2" 3" Va ½ 3/8 1/2' 3/8 1/2'	I lve Size * to ½" Style 605 * to ¾" Style 625 * to 1" Style 687	S001 S002 S003 S004 S005	1/4" 1/2" 3/4" 1" 1 1/2"
					Model Code ITT 1001 1002 1003 1004 1005 1006 1007 1008 1009	e Valve Size 1/2" (Biotek) 1/2" 3/4" 1" 11/2" Style 33 2" 2" Style 33	A001 A002 A003 A004 GEMU G001	12" 1" 2" 3" Va ½ 3/8 ½ 1½	I lve Size " to ½" Style 605 " to ¾" Style 625	S001 S002 S003 S004 S005	1/4" 1/2" 3/4" 1" 1 1/2"
					Model Code ITT 1001 1002 1003 1004 1005 1006 1007 1008 1009	e Valve Size 1/4" (Biotek) 1/2" 3/4" 1" 11/2" Style 33 2" 2" Style 33 3" and 4" Style 3" and 4" Style 3" and 4" Style	A001 A002 A003 A004 GEMU G001 Le 47 G002 Le 33 G003	12" 2" 3" Va 1/2 3/8 1/2 11/ 2"	Ilve Size * to 1⁄2" Style 605 * to 3⁄4" Style 625 * to 1" Style 687 2" Style 687	S001 S002 S003 S004 S005	1/4" 1/2" 3/4" 1" 1 1/2"
					Model Code ITT 1001 1002 1003 1004 1005 1006 1007 1008 1009	e Valve Size 1/4" (Biotek) 1/2" 3/4" 1" 11/2" Style 33 2" 2" Style 33 3" and 4" Style 3" and 4" Style 3" and 4" Style	A001 A002 A003 A004 GEMU G001 Le 47 G002 G003 G004 sition transmit	12" 2" 3" Va 1/2 3/8 1/2 11/ 2"	Ilve Size * to 1⁄2" Style 605 * to 3⁄4" Style 625 * to 1" Style 687 2" Style 687	S001 S002 S003 S004 S005	1/4" 1/2" 3/4" 1" 1 1/2"
					Model Code ITT 1001 1002 1003 1004 1005 1006 1007 1008 1009	e Valve Size 1/4" (Biotek) 1/2" 3/4" 1" 11/2" 11/2" 11/2" 2" Style 33 2" 2" Style 33 2" 2" Style 33 3" and 4" Styl 3" and 4" Styl Analog po 00 None	A001 A002 A003 A004 GEMU G001 Le 47 G002 G003 G004 sition transmit	12" 2" 3" Va 1/2 3/8 1/2 11/ 2"	Ilve Size * to 1⁄2" Style 605 * to 3⁄4" Style 625 * to 1" Style 687 2" Style 687	S001 S002 S003 S004 S005	1/4" 1/2" 3/4" 1" 1 1/2"
					Model Code ITT 1001 1002 1003 1004 1005 1006 1007 1008 1009	e Valve Size 1/2" (Biotek) 1/2" 3/4" 1" 11/2" Style 33 2" 2" Style 33 2" 2" Style 33 3" and 4" Styl 3" and 4" Styl Analog po 00 None Co	A001 A002 A003 A004 GEMU G001 e G02 G003 G004 sition transmit e bil Voltage	12" 2" 3" Va 1/2 3/8 1/2 11/ 2"	Ilve Size * to 1⁄2" Style 605 * to 3⁄4" Style 625 * to 1" Style 687 2" Style 687	S001 S002 S003 S004 S005	1/4" 1/2" 3/4" 1" 1 1/2"
					Model Code ITT 1001 1002 1003 1004 1005 1006 1007 1008 1009	e Valve Size 1/4" (Biotek) 1/2" 3/4" 1" 11/2" 11/2" 11/2" 2" Style 33 2" 2" Style 33 2" 2" Style 33 3" and 4" Styl 3" and 4" Styl Analog po 00 None	A001 A002 A003 A004 GEMU G001 G001 G001 G002 G003 G004 sition transmit e poil Voltage D None**	الالا 17 2° 3° Va ½2° 1½ 1½ 1½ 2° ter	Ive Size [*] to ½" Style 605 [*] to ¾" Style 625 [*] to 1" Style 687 [*] Style 687 Style 687	S001 S002 S003 S004 S005	1/4" 1/2" 3/4" 1" 1 1/2"
					Model Code ITT 1001 1002 1003 1004 1005 1006 1007 1008 1009	e Valve Size 1/2" (Biotek) 1/2" 3/4" 1" 11/2" Style 33 2" 2" Style 33 2" 2" Style 33 3" and 4" Styl 3" and 4" Styl Analog po 00 None Co	A001 A002 A003 A004 GEMU G001 G001 G003 G004 sition transmit e coil Voltage D None** Falcon	لا را	Ive Size [*] to ½" Style 605 [*] to ¾" Style 625 [*] to 1" Style 687 [*] Style 687 Style 687	S001 S002 S003 S004 S005	1/4" 1/2" 3/4" 1" 1 1/2"
					Model Code ITT 1001 1002 1003 1004 1005 1006 1007 1008 1009	e Valve Size 1/2" (Biotek) 1/2" 3/4" 1" 11/2" Style 33 2" 2" Style 33 2" 2" Style 33 3" and 4" Styl 3" and 4" Styl Analog po 00 None Co	A001 A002 A003 A004 GEMU G001 G001 G003 G004 sition transmit e coil Voltage D None** Falcon	V2 1" 2" 3" Va ½ 3/6 ½ 1½ 1½ 2" 1½ 2" 1½ 2" 1½ 2" 1½ 2" 1½ 1½ 2" 1½ 1½ 2" 1½ 2" 1½ 2" 1½ 2" 1½ 2" 2" 1% 2" 2" 2" 2" 2" 2" 2" 2" 2" 2" 2" 2" 2"	Ive Size ' to ½" Style 605 ' to 34" Style 625 ' to 1" Style 687 2" Style 687 Style 687 Style 687	S001 S002 S003 S004 S005	1/4" 1/2" 3/4" 1" 1 1/2"
					Model Code ITT 1001 1002 1003 1004 1005 1006 1007 1008 1009	e Valve Size 1/2" (Biotek) 1/2" 3/4" 1" 11/2" Style 33 2" 2" Style 33 2" 2" Style 33 3" and 4" Styl 3" and 4" Styl Analog po 00 None Co	A001 A002 A003 A004 GEMU G001 G001 G003 G004 sition transmit e coil Voltage D None** Falcon	Valve Body lone** Special	• • to ½" Style 605 • to ½" Style 625 • to 1" Style 687 \$' Style 687 Style 687 • • • • • • • • • • • • •	S001 S002 S003 S004 S005	1/4" 1/2" 3/4" 1" 1 1/2"
					Model Code ITT 1001 1002 1003 1004 1005 1006 1007 1008 1009	e Valve Size 1/2" (Biotek) 1/2" 3/4" 1" 11/2" Style 33 2" 2" Style 33 2" 2" Style 33 3" and 4" Styl 3" and 4" Styl Analog po 00 None Co	A001 A002 A003 A004 GEMU G001 G001 G003 G004 sition transmit e coil Voltage D None** Falcon	Valve Body lone** Special	Ive Size ' to ½" Style 605 ' to 34" Style 625 ' to 1" Style 687 2" Style 687 Style 687 Style 687	S001 S002 S003 S004 S005	1/4" 1/2" 3/4" 1" 1 1/2"
					Model Code ITT 1001 1002 1003 1004 1005 1006 1007 1008 1009	e Valve Size 1/2" (Biotek) 1/2" 3/4" 1" 11/2" Style 33 2" 2" Style 33 2" 2" Style 33 3" and 4" Styl 3" and 4" Styl Analog po 00 None Co	A001 A002 A003 A004 GEMU G001 G001 G003 G004 sition transmit e coil Voltage D None** Falcon	Valve Body lone** Special	• • to ½" Style 605 • to ½" Style 625 • to 1" Style 687 \$' Style 687 Style 687 • • • • • • • • • • • • •	S001 S002 S003 S004 S005 S006	1/4" 1/2" 3/4" 1" 1 1/2"
					Model Code ITT 1001 1002 1003 1004 1005 1006 1007 1008 1009	e Valve Size 1/2" (Biotek) 1/2" 3/4" 1" 11/2" Style 33 2" 2" Style 33 2" 2" Style 33 3" and 4" Styl 3" and 4" Styl Analog po 00 None Co	A001 A002 A003 A004 GEMU G001 G001 G003 G004 sition transmit e coil Voltage D None** Falcon	Valve Body lone** Special	Ne Size to ½" Style 605 to ½" Style 625 to 1" Style 687 2" Style 687 Style 687 V Valve Features one**	S001 S002 S003 S004 S005 S006	1/4" 1/2" 3/4" 1" 1 1/2"
881	0	ΜΙ	28		Model Code ITT 1001 1002 1003 1004 1005 1006 1007 1008 1009	e Valve Size 1/2" (Biotek) 1/2" 3/4" 1" 11/2" Style 33 2" 2" Style 33 2" 2" Style 33 3" and 4" Styl 3" and 4" Styl Analog po 00 None Co	A001 A002 A003 A004 GEMU G001 G001 sition transmit e oil Voltage ONone** Falcon 00 N	Valve Body lone** Special	Ive Size To 1/2" Style 605 To 3/4" Style 625 To 1" Style 687 2" Style 687 Style 687 Style 687 Verriee Determine 0 None**	S001 S002 S003 S004 S005 S006	1/4" 1/2" 3/4" 1" 1 1/2"

US/Canada: Saddle Brook, NJ

Ph: +1 201 794 7650 Fax: +1 201 794 0913 E-mail: westlockinfo@westlockcontrols.com E-mail: comercial@westlock.com.br

South America: Sao Paulo, Brazil Ph: +55 11 2588 1400 Fax: +55 11 2588 1410

Europe: Kent, England

Ph: +44 1892 516277 Fax: +44 1892 707620 E-mail: sales@westlockuk.com

Asia: Singapore

Ph: +65 6768 5850

E-mail: sales@westlockuk.com